

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003047 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:26A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR GIRLS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	4.4 ppb	0-15 ppb	SM 22 3113B

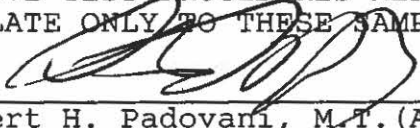
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003040 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT~~ BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:24A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 3RD FLOOR FACULTY MENS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003041 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:25A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR FACULTY WOMENS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003042 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~DAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:27A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR JANITOR SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003043 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:23A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR WATER FOUNTAIN RT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003044 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:23A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR WATER FOUNTAIN LT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003045 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:25A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; LIBRARY SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

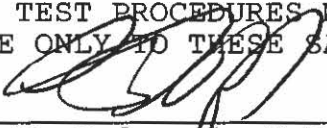
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003046 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:26A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR BOYS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003048 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:33A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;1ST FLOOR BOYS ROOM SINK
: BY 100

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003049 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:34A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;1ST FLOOR GIRLS SINK
: BY 100

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003050 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLENO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:29A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;118 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	3.3 ppb	0-15 ppb	SM 22 3113B

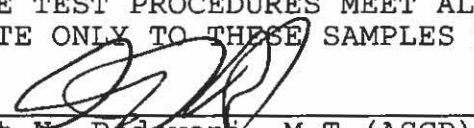
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003051 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:33A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;1ST FLOOR JANITOR SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003052 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~DAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:32A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;1ST FLOOR FACULTY MEN SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003053 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:31A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;1ST FLOOR FACULTY WOMEN
: SINK
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003054 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:38A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;BOYS ROOM NEW ATHLETIC
: OFFICE
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.7 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003055 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:37A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;GIRLS ROOM NEW ATHLETIC
: OFFICE
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003056 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:41A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; WATER FOUNTAIN
: NEW ATHLETIC OFFICE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

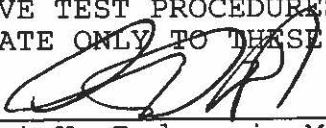
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003057 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:39A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;BOTTLE FILLER NEAR
: NEW ATHLETIC OFFICE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003059 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:39A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; WATER FTN ACROSS FROM 104L
:
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003058 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:39A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: WATER FTN ACROSS FROM 104 R
: HIGH SCHOOL
COL'D BY: CAREY CLERICI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003060 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~DAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:45A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;GIRLS LOCKER ROOM

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003061 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:43A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;BOYS LOCKER ROOM

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003062 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:48A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;TEAM LOCKER ROOM

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	6.7 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003063 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~DAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:42A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;132 ICE MACHINE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

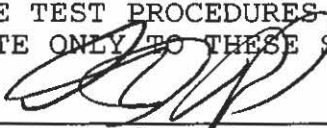
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003064 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: ~~PAT BELLINO~~
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:45A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;132 COLD WATER TAP

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003087 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:13A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN PREP SOUTH

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/01/20 LEAD (IMS) 2.0 ppb 0-15 ppb SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003088 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:11A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN PREP SOUTH

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	1.8 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003089 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:09A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN PREP WEST

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	1.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003090 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:08A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN PREP CENTER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003091 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:12A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN 2 BAY

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	3.2 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003092 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:10A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN HAND WASH

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003093 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:09A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN RINSE DOWN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

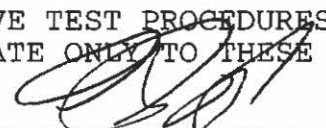
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003094 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:12A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN STATIONARY POT
: FILLER RIGHT

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003095 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:12A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN STATIONARY POT
: FILLER LEFT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003096 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:07A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN RESTROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/01/20 LEAD (IMS) <1.0 ppb 0-15 ppb SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003098 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:13A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN HAND HELD KETTLE
: FILLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	9.3 ppb	0-15 ppb	SM 22 3113B

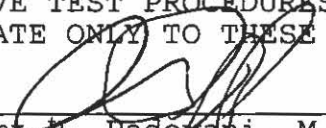
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003097 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:11A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; KITCHEN 3 BAY SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

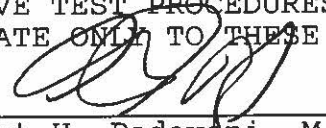
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003076 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:58A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; NURSE HAND WASH

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003077 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:59A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; NURSE BATHROOM

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003078 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:59A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 235A

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003079 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:01A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; WATER FTN LEFT PAC

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003080 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:01A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; WATER FTN RIGHT PAC

SAMPLE TYPE.: POTABLE

COL'D BY: CAREY CLERICI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C NOT ON ICE

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003081 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:03A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; JANITOR SINK BY PAC

SAMPLE TYPE.: POTABLE

COL'D BY: CAREY CLERICI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C NOT ON ICE

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003082 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:02A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL:GIRLS ROOM SINK BY PAC

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003084 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:03A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;GIRLS ROOM SINK BY RECEIVING

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003085 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:04A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;BOYS ROOM BY RECEIVING

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003086 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 06:05A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;CUSTODIAL OFFICE SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/01/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003075 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:52A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; ROOM 215 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	19.2 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

LEAD RESULTS EXCEEDS THE MCL LEVEL OF 15 PPB
MCL = MAXIMUM CONTAMINANT LEVEL; NOTIFIED CLIENT 10/5/20; RP

COMMENTS:

Ph/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.

(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003065 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:36A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;MAIN OFFICE KITCHEN SINK

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003066 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:56A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;MAIN OFFICE MENS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003067 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:57A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;MAIN OFFICE WOMAN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003068 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:53A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 2ND FACULTY MENS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003069 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:53A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 2ND FACULTY WOMAN
:
COL'D BY: CAREY CLERICI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003070 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:51A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;2ND FLR WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003071 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:51A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;BOTTLE FILLER 202

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003072 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/ 20 05:54A
DATE/TIME REC'D: 09/22/ 20 11:40A
REPORT DATE: 10/05/ 20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;2ND BOYS SINK 202

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003073 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:52A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 2ND GIRLS SINK 202

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003074 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:52A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/05/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;2ND JANITOR SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/30/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003047 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:26A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 3RD FLOOR GIRLS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	4.4 ppb	0-15 ppb	SM 22 3113B

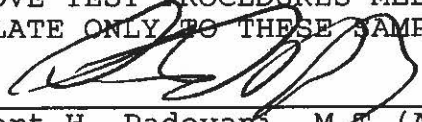
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003040 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:24A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 3RD FLOOR FACULTY MENS
:
COL'D BY: CAREY CLERICI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003041 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:25A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR FACULTY WOMENS
:
COL'D BY: CAREY CLERICI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003042 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:27A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 3RD FLOOR JANITOR SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003043 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:23A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 3RD FLOOR WATER FOUNTAIN RT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003044 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:23A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 3RD FLOOR WATER FOUNTAIN LT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003045 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:25A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; LIBRARY SINK

SAMPLE TYPE.: POTABLE

COL'D BY: CAREY CLERICI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C NOT ON ICE

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

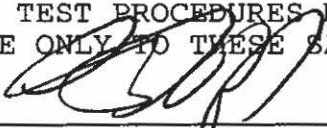
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003046 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:26A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 09/25/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;3RD FLOOR BOYS

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003048 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 09/22/20 05:33A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 09/22/20 11:40A
ATTN: PAT BELLINO REPORT DATE: 10/02/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;1ST FLOOR BOYS ROOM SINK SAMPLE TYPE.: POTABLE
: BY 100 PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 15C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003049 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:34A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;1ST FLOOR GIRLS SINK
: BY 100
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003050 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:29A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;118 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/23/20			LEAD (IMS)	3.3 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003051 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:33A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 1ST FLOOR JANITOR SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003052 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:32A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 1ST FLOOR FACULTY MEN SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

09/25/20 LEAD (IMS) <1.0 ppb 0-15 ppb SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003053 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:31A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; 1ST FLOOR FACULTY WOMEN
: SINK
COL'D BY: CAREY CLERICI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003054 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:38A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;BOYS ROOM NEW ATHLETIC
: OFFICE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.7 ppb	0-15 ppb	SM 22 3113B

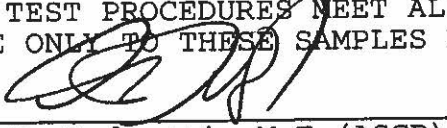
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003055 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:37A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; GIRLS ROOM NEW ATHLETIC
: OFFICE

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003056 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:41A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; WATER FOUNTAIN
: NEW ATHLETIC OFFICE

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003057 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:39A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; BOTTLE FILLER NEAR
: NEW ATHLETIC OFFICE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003059 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:39A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL; WATER FTN ACROSS FROM 104L

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

09/25/20 LEAD (IMS) <1.0 ppb 0-15 ppb SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003058 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:39A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: WATER FTN ACROSS FROM 104 R
: HIGH SCHOOL

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003060 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:45A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;GIRLS LOCKER ROOM

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003061 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:43A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;BOYS LOCKER ROOM

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	1.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003062 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:48A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;TEAM LOCKER ROOM

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	6.7 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003063 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:42A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;132 ICE MACHINE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

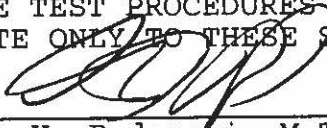
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003064 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: PAT BELLINO
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 09/22/20 05:45A
DATE/TIME REC'D: 09/22/20 11:40A
REPORT DATE: 10/02/20
PHONE: (914)-526-8900

SAMPLING SITE: HIGH SCHOOL;132 COLD WATER TAP

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/25/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003333 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/06/20 05:32A
DATE/TIME REC'D: 10/06/20 09:30A
REPORT DATE: 10/17/20
PHONE: (914)-526-8900

SAMPLING SITE: ROOM 215 REDO; HIGH SCHOOL CONFIRMATION

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/14/20			LEAD (IMS)	3.1 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323